


Stair Replacement

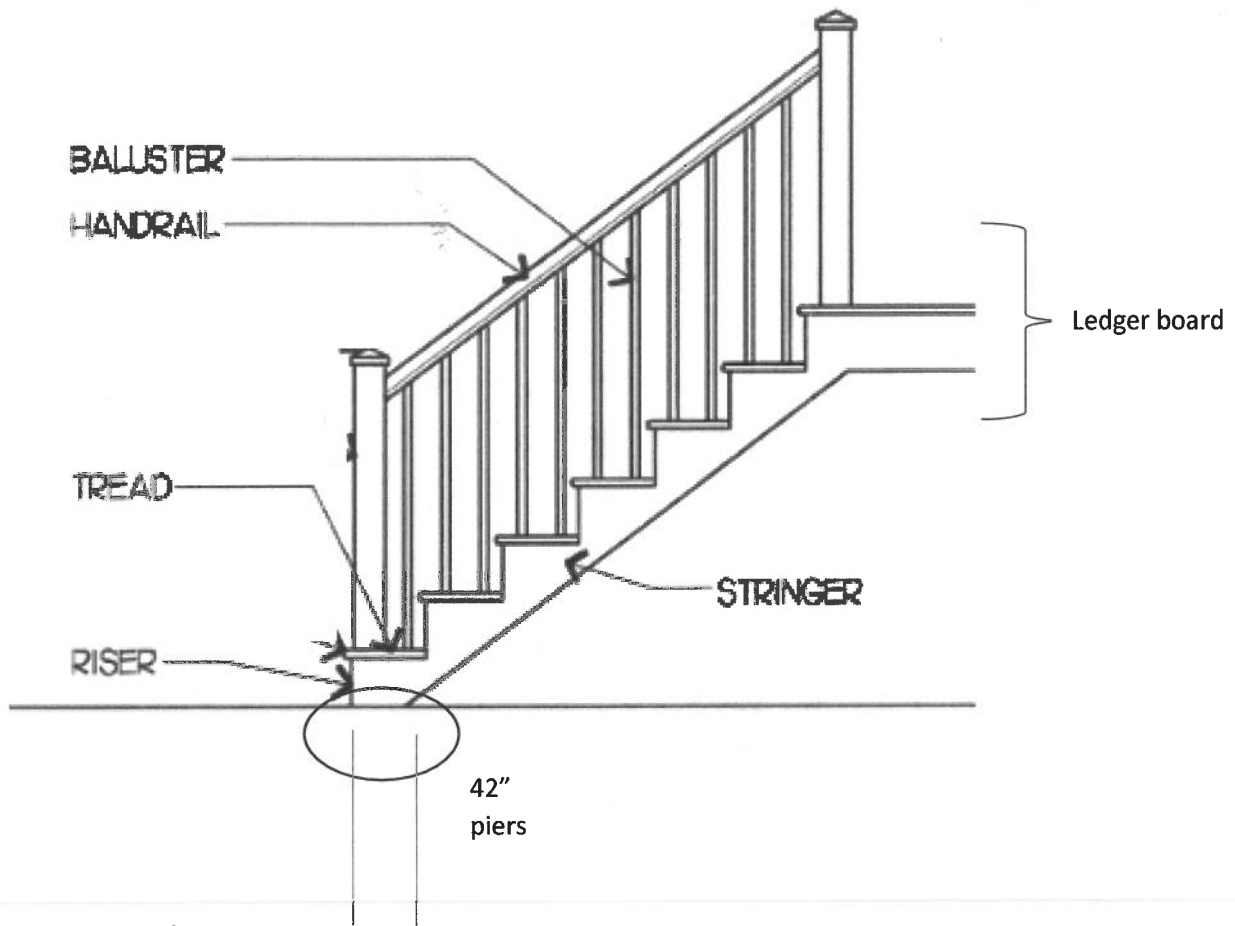

Stair Codes

- Riser shall be 7 $\frac{3}{4}$ " maximum
- Treads shall be 10" minimum
- Balusters shall be space no more than 4" apart – 6" on center
- Guardrails shall be 36" high minimum
- The bottom riser of the stairs must be supported on concrete piers that extend below the frost line (42" minimum below grade)
- All beams shall be DOUBLE MEMBERS